

GROUND FAULT CIRCUIT INTERRUPT  
 JUNCTION BOX  
3C/EQ-EL LEGEND - EQUIPMENT - ELECTRICAL  
1/4"=1'-0"

5B/EQ-EL EQUIPMENT PLAN - ELECTRICAL  
1/4"=1'-0"

TYPE MARK	COUNT	DESCRIPTION	COMMENTS
#3	1	CORNER DISHWASHER	120/1 20.0 AMP. (15.9 AMP. DRAW) J-BOX 68" AFF. (FOR DISHWASHER BY OWNER, EC TO VERIFY WITH THE OWNER'S MACHINE)
#3A	1	AB 10 BOOSTER HEATER	208 V/3 - 21 RATED AMPS - 24 A MIN. CIRCUIT - 30A MAX. BREAKER (OR 208 V/1 - 36 RATED AMPS - 42 A MIN. CIRCUIT - 45A MAX. BREAKER)
#9	1	REACH-IN FREEZER	120/1 15.0 AMP. (6.3 AMP. DRAW) G.F.I. D.O. DFA TO 60" AFF.
#10	1	REACH-IN REFRIGERATOR	120/1 15.0 AMP. (3.2 AMP. DRAW) G.F.I. D.O. DFA TO 60" AFF.
#12A	1	RICE / GRAIN COOKER	120/1 (12.5 AMP. EQUIPMENT DRAW - NEMA 5-15P) G.F.I. D.O. 42" AFF.
#16	1	DOUBLE DECK GAS CONVECTION OVEN	(2) 120/1 15.0 AMP. D.O. 36" AFF.
#18	1	UNDERCOUNTER REFRIGERATOR	120/1 15.0 AMP. G.F.I. D.O. 28" AFF.
#24	1	72.7" MEGA TOP	120/1 (2.8 AMP. EQUIPMENT DRAW - NEMA 5-15P) G.F.I. D.O. 26" AFF. (EC TO MOUNT RECEPTACLE IN PARTIAL HEIGHT VERTICAL KNEE WALL)
#25	2	60.2" MEGA TOP	120/1 (2.8 AMP. EQUIPMENT DRAW - NEMA 5-15P) G.F.I. D.O. 26" AFF. (EC TO MOUNT RECEPTACLE IN PARTIAL HEIGHT VERTICAL KNEE WALL)
#26	1	27.5" MEGA TOP	120/1 (2.3 AMP. EQUIPMENT DRAW - NEMA 5-15P) G.F.I. D.O. 26" AFF. (EC TO MOUNT RECEPTACLE IN PARTIAL HEIGHT VERTICAL KNEE WALL)
#27A	1	FOOD PAN WARMER, COUNTERTOP	120/1 15.0 AMP. G.F.I. D.O. 26" AFF. (EC TO MOUNT RECEPTACLE IN PARTIAL HEIGHT VERTICAL KNEE WALL)
#28	1	HOT FOOD SERVING COUNTER / TABLE	120/1 (16 AMP. EQUIPMENT DRAW - NEMA 5-20P) G.F.I. D.O. 26" AFF. (EC TO MOUNT RECEPTACLE IN PARTIAL HEIGHT VERTICAL KNEE WALL)
#30	1	OPEN DISPLAY MERCHANDISER	120/1 (12.0 AMP. EQUIPMENT DRAW - NEMA 5-15P) D.O. 26" AFF. (EC TO MOUNT RECEPTACLE INSIDE COUNTER CABINET BASE, ONCE COUNTER IS SET IN PLACE) NOTE TO EC: IF A G.F.I. IS REQUIRED, PUT IN G.F.I. BREAKER IN LIEU OF RECEPTACLE.
POS	1	POS - POWER	NEW 120/1 15.0 AMP. CONDUIT STUB. STUB-UP 8" AFF. (EC TO ADD RECEPTACLE AND BOX INSIDE COUNTER BASE AFTER COUNTER IS SET IN PLACE)
POS1	1	POS - CONDUIT STUB	120/1 EMPTY CONDUIT STUB. STUB-UP 8" AFF. (EC TO ADD DATA BOX INSIDE COUNTER AFTER COUNTER IS SET IN PLACE) (EC TO CONFIRM THE FINAL RUN TO LOCATION WITH THE OWNER)

5A/EQ-EL EQUIPMENT - ELECTRICAL



Owner: Forage Kitchen  
5352 King James Way  
Fitchburg, WI 53719  
eatforage.com




GC: Venture Construction Group  
17500 W. Liberty Lane  
New Berlin, WI 53146  
vcginc.com



Kitchen Supplier: Kavanaugh  
2920 Bryant Road  
Madison, WI 53713  
608.271.8514



Architect: Opening Design  
17 S Fairchild | FL 7  
Madison, WI 53703  
ryan@openingdesign.com | 773.425.6456

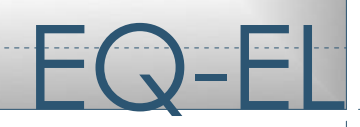

This project, like most Opening Design's projects, is open source. (Attribution-ShareAlike 4.0 International=CC-BY-SA 4.0)=freely available to any party for future use, assuming the terms such as Attribution and ShareAlike are honored.